



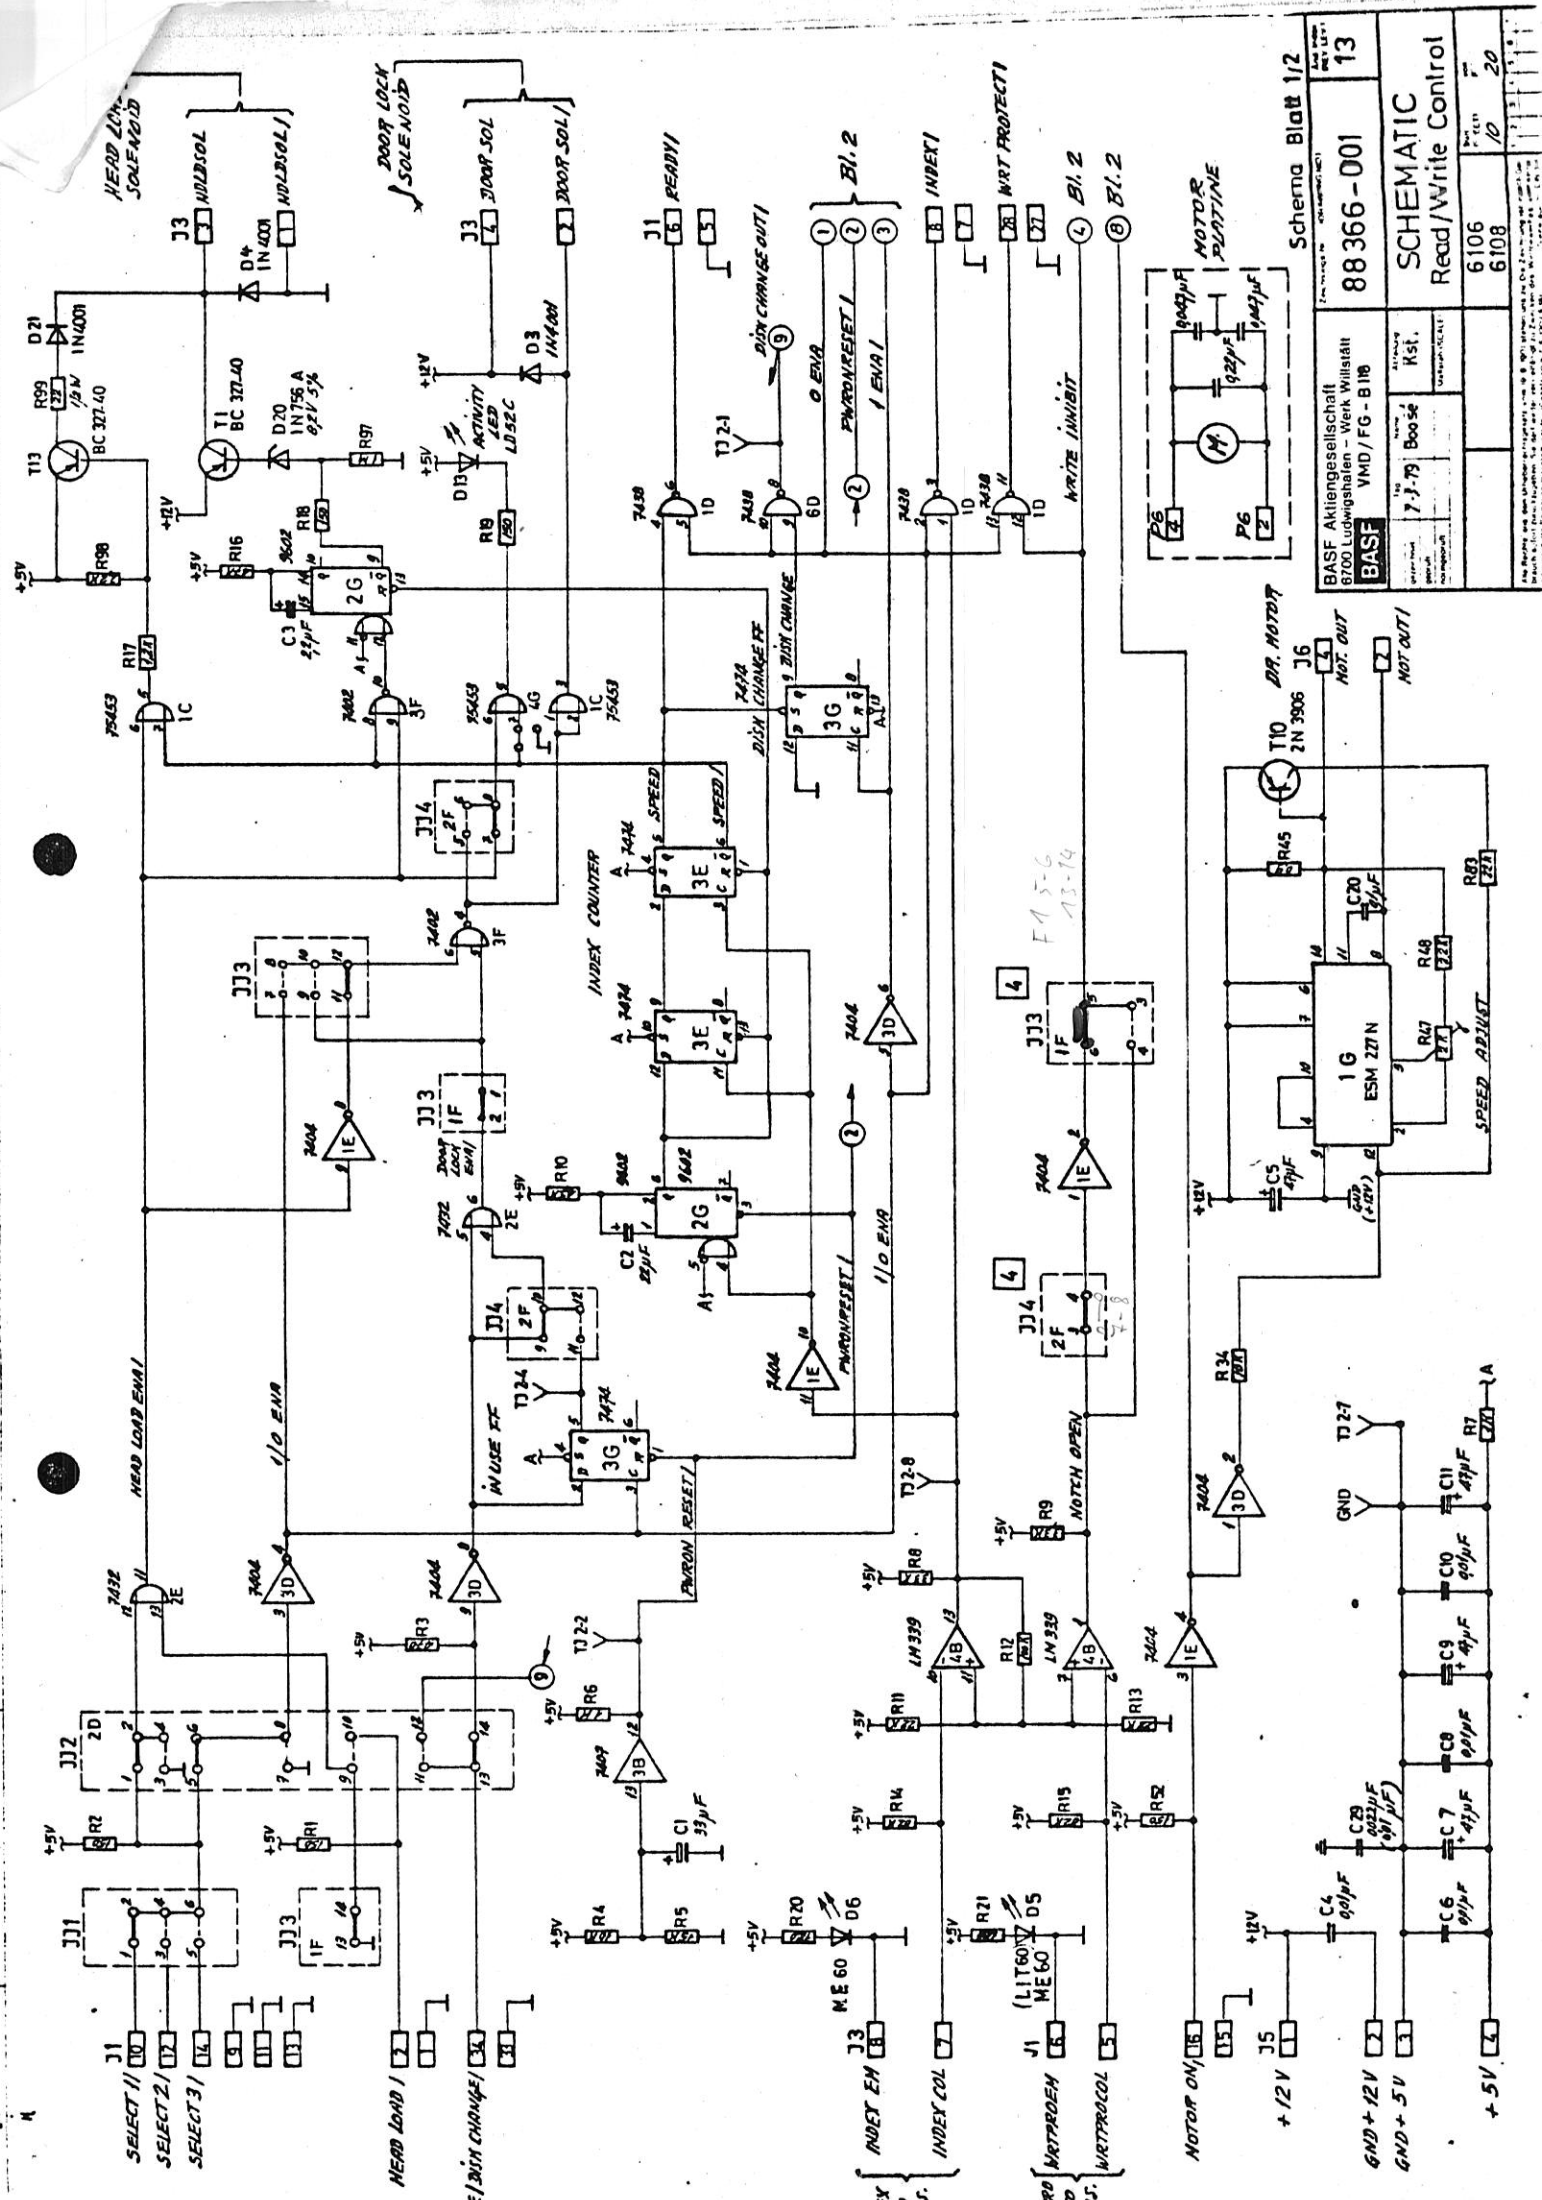

Schema Blatt 1/2		88 366-001	13
BASF Aktiengesellschaft 8700 Ludwigshafen - Werk Willstätt VMD / FG - B 118		SCHEMATIC Read/Write Control	
7-3-79 Boose		6106	10
Kst.		6108	20

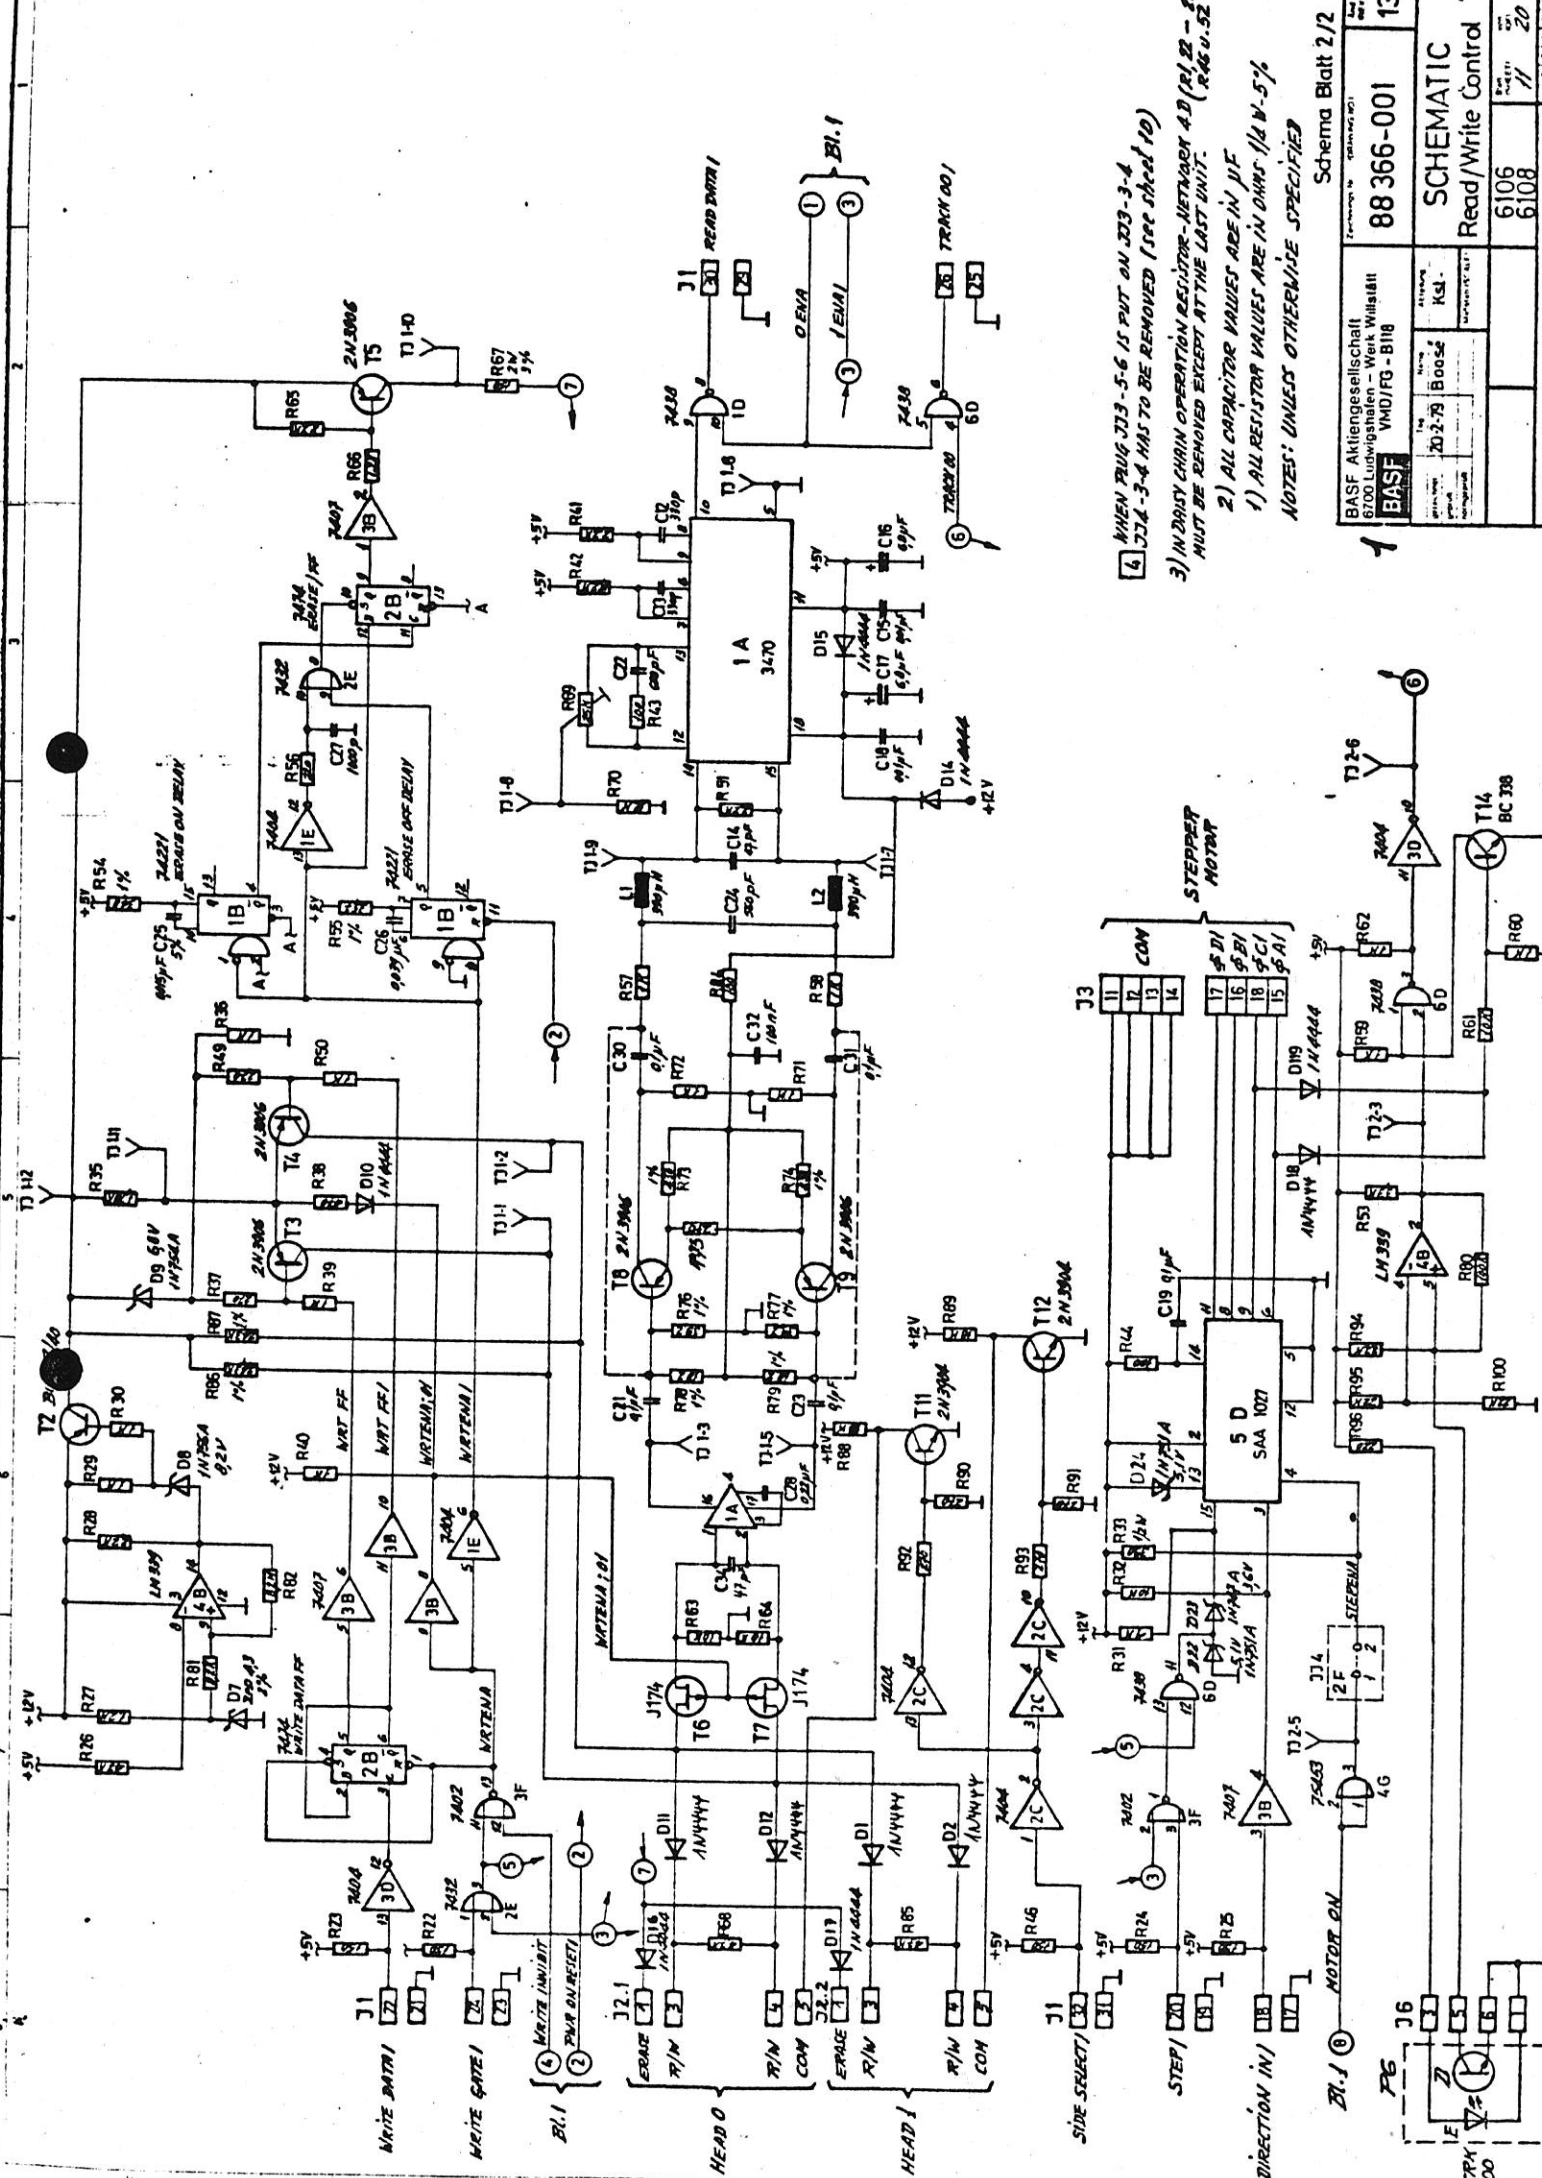

6 WHEN PLUG J13-5-6 IS PUT ON J13-3-4
 3) IN DASH CHAIN OPERATION RESISTOR NETWORK A3 (A1, A2 - 25) MUST BE REMOVED EXCEPT AT THE LAST UNIT.
 2) ALL CAPACITOR VALUES ARE IN μF
 1) ALL RESISTOR VALUES ARE IN OHMS - 1/4 W-5%
 NOTES: UNLESS OTHERWISE SPECIFIED

Schema Blatt 2/2		88 366-001		13	
BASF Aktiengesellschaft 6700 Ludwigshafen - Werk Wilsbib		VMD/FG - B18		KSL	
BASF		20-2-79		Boose	
SCHEMATIC		Read/Write Control		6106	
				6108	
				11	
				20	